This standard plan complies with fire-resistive construction requirements for Wildland-Urban Interface (WUI) areas


| PATIC       | COVER REQUIREMENTS:  |
|-------------|--|
|             | Patio covers are one-story structures not exceeding 12 feet in height. Patio covers shall be used for recreational, outdoor living purposes and not as carports, garages, storage rooms or habitable rooms. Openings shall be permitted to be enclosed with insect screening. Enclosure walls shall be permitted to be any configuration, provided the open area of the longer wall and one additional wall is equal to at least 65% of the area below a minimum of 6'-8" of each wall, measured from the floor. Exterior openings required for light and ventilation shall be permitted to open into a patio structure. However, the patio structure shall be completely unenclosed if such openings are serving as emergency egress or rescue openings from sleeping rooms. Where the patio cover is connected to an existing building there shall be no window, door, or other openings under the patio cover that are greater than 6 feet wide, unless otherwise justified. The California Building Code requires that the minimum distance from property line to the proposed patio cover shall be 5 feet. Please see the Zoning Ordinance for zoning requirements. |
| <u>CARP</u> | ORT REQUIREMENTS:  |
|             | Carports shall be entirely open on two or more sides.  Where the carport is connected to an existing building there shall be no window, door, or other openings under the carport that are greater than 6 feet wide, unless otherwise justified.  Minimum distance from property line to proposed carport shall be 5 feet.   |
| <u>GENE</u> | RAL REQUIREMENTS:  |
| 0000        | No modification shall be made to these plans unless approval is obtained. The use of this standard plan is limited to residential occupancies and accessory structures. This plan must be accompanied by a plot plan prepared in compliance with Plot Plan Minimum Requirements (PDS 090).  All work shall comply with the current <i>California Building Code</i> and/or current <i>California Residential Code</i> , as amended and adopted by the County of San Diego.  Minimum Construction Specifications (PDS 081) shall be used in conjunction with this plan.  Outdoor lighting shall comply with the County of San Diego Outdoor Lighting Ordinance.  Outdoor lighting fixtures shall be high-efficacy luminaires or a photo-control/motion-sensor combination. Framing members shall be Douglas Fir-Larch #2 or better.  Fasteners for preservative treated wood shall be of hot dipped zinc-coated galvanized steel, stainless  |

☐ The horizontal distance from the bottom leading edge of footings to daylight shall be 7'-0" minimum.


 $\Box$  Concrete mix for footings shall have a minimum compressive strength of  $f'_c = 2,500$  psi.

PDS 078 REV: 01/01/2023


steel, silicon bronze, or copper.

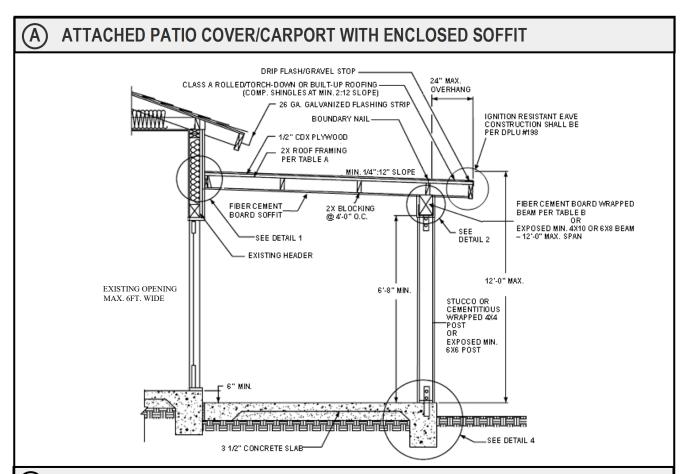

#### B ATTACHED PATIO COVER/CARPORT WITH EXPOSED HEAVY TIMBER FRAMING

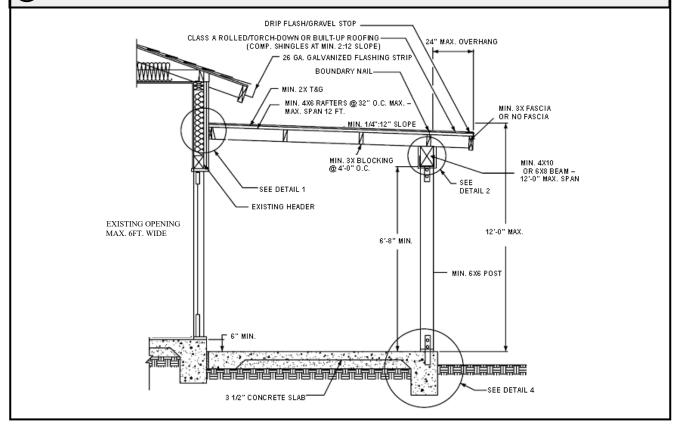

### © DETACHED PATIO COVER/CARPORT WITH EXPOSED HEAVY TIMBER FRAMING

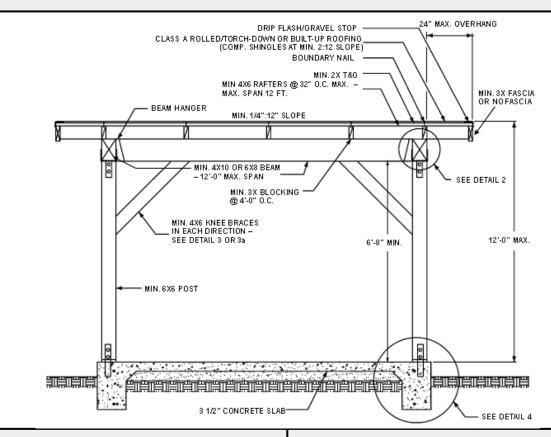

#### TABLE A: MINIMUM RAFTER SIZES\*

| Rafter<br>Span | Rafter Spacing (center-to-center) |     |     |  |  |
|----------------|-----------------------------------|-----|-----|--|--|
| (Ft.)          | 12"                               | 16" | 24" |  |  |
| 6              | 2x4                               | 2x4 | 2x4 |  |  |
| 8              | 2x4                               | 2x4 | 2x6 |  |  |
| 10             | 2x6                               | 2x6 | 2x6 |  |  |
| 12             | 2x6                               | 2x6 | 2x8 |  |  |

\*Rafters of less than 4x6 nominal size shall be approved fire-retardant treated lumber or protected by fiber cement board.


#### **TABLE B: MINIMUM BEAM SIZES\***


| Post    | Rafter Span |      |      |      |  |
|---------|-------------|------|------|------|--|
| Spacing | 6           | 8    | 10   | 12   |  |
| (Ft.)   | Ft.         | Ft.  | Ft.  | Ft.  |  |
| 4       | 4x4         | 4x4  | 4x4  | 4x4  |  |
| 6       | 4x4         | 4x4  | 4x6  | 4x6  |  |
| 8       | 4x6         | 4x6  | 4x6  | 4x8  |  |
| 10      | 4x8         | 4x8  | 4x8  | 4x8  |  |
| 12      | 4x8         | 4x10 | 4x10 | 4x10 |  |

<sup>\*</sup> Beams of less than 4x10 or 6x8 nominal size shall be approved fire-retardant treated lumber or protected by fiber cement board.

#### **TABLE C: FOOTING WIDTH "W"**


| Post Spacing | Rafter Span (Ft.) |     |     |     |
|--------------|-------------------|-----|-----|-----|
| (Ft.)        | 6                 | 8   | 10  | 12  |
| 4            | 12"               | 12" | 12" | 12" |
| 6            | 12"               | 12" | 12" | 14" |
| 8            | 12"               | 14" | 14" | 16" |
| 10           | 14"               | 16" | 16" | 18" |
| 12           | 16"               | 16" | 18" | 18" |

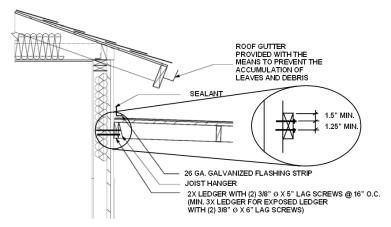


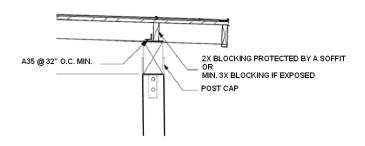

## 1 LEDGER AT EXISTING WALL


# BEAM TO POST CONNECTION PROVIDE BRACING AT ALL POSTS PER DETAILS 3 & 3A






(3) KNEE-BRACE

### (3A) KNEE-BRACE @ CORNER

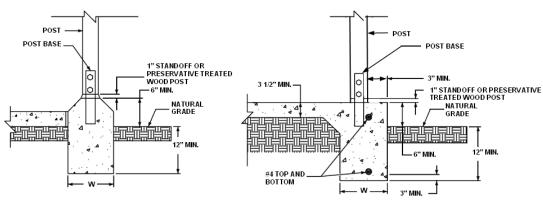

4 PIER FOOTING
SQUARE "W"X"W" (SEE TABLE C)

## ALTERNATE CONTINUOUS FOOTING (SEE TABLE C)



5) OPTIONAL TRELLIS DETAIL PROVIDE BRACING AT ALL POSTS PER DETAILS 3 & 3A